

東芝ノーヒューズ遮断器・漏電遮断器 compact NJ シリーズ
TOSHIBA NO-FUSE CIRCUIT BREAKERS, EARTH LEAKAGE CIRCUIT BREAKERS

端子カバー (ロングタイプ) (CF)
Terminal covers (Long type) (CF)
400AF~800AF

安全上のご注意

取付け、配線工事、操作および保守・点検を行う前に、取扱説明書、取扱と保守マニュアルなどをよくお読みの上、正しくご使用ください。また必要に応じて、取扱説明書などが最終の使用責任者の元に届くよう、ご配慮願います。取扱と保守マニュアルは支社、営業所にご請求ください。

・ここでは、安全上の注意事項のレベルを「危険」および「注意」として区分してあります。

⚠ 危険 : 取扱いを誤った場合に、死亡または重傷を受ける可能性があります。

⚠ 注意 : 取扱いを誤った場合に、中程度の傷害や軽傷を受ける可能性あるいは物的損害が発生する可能性があります。

なお、**⚠ 注意** に記載した事項でも、状況によっては重大な結果に結びつく可能性があります。

⚠ 危険

- ・取付け、取外し、配線作業および保守・点検は必ず上位遮断器を切って行ってください。感電および短絡による火傷のおそれがあります。
- ・裸充電部には絶対に触らないでください。感電するおそれがあります。

⚠ 注意

- ・取付け、電気工事および保守・点検は専門知識を持つ有資格者が行ってください。
- ・製品を廃棄する場合は、産業廃棄物として取り扱ってください。

SAFETY PRECAUTIONS

Before installation, wiring, operation, maintenance and inspection of the device, be sure to read the operating instructions carefully to ensure proper operation. Care should be taken that the operating instructions will be furnished to the maintenance supervisors of final users.

- ・ Safety precautions items are classified into "Warning" and "Caution".

⚠ WARNING : Incorrect handling of the device may result in death or serious injury.

⚠ CAUTION : Incorrect handling of the device may result in minor injury or physical damage.

Even some "Caution" items may also result in a serious accident.

⚠ WARNING

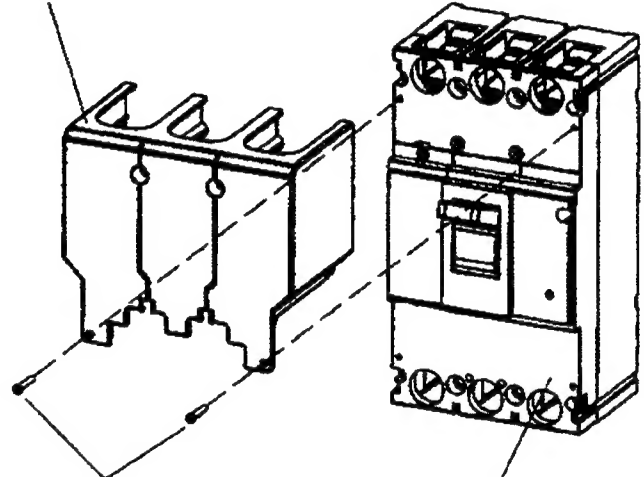
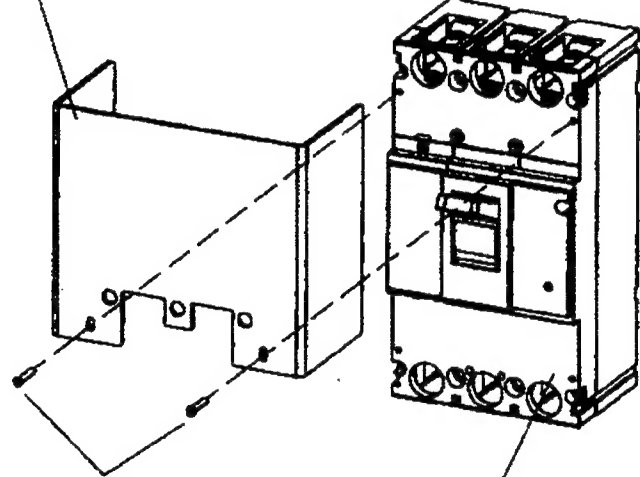
- ・ Turn off the upstream circuit breaker prior to installation, removal, wiring, maintenance or inspection to prevent electric shocks and burns due to short-circuit.
- ・ Do not touch live line. Electric shock occurs.

⚠ CAUTION

- ・ Installation, electric work, maintenance and inspection of the device should be performed by qualified engineers having special knowledge.
- ・ When the device is to be disposed of, it should be handled as an industrial waste.

| 端子カバー形式 Terminal covers | ブレーカ適用基本形式 Compatible breaker basic type | | | |
|--------------------------------------|--|----------------------------|--------------------|--------------------|
| | ノーヒューズ遮断器 MCCB | | 漏電遮断器 ELCB | |
| | 経済形 | 汎用標準形 | 経済形 | 汎用標準形 |
| XCFN40A3 | NJ400F | NJ400N NJ400H | NJV400F | NJV400N |
| XCFN80A3 | NJ600F NJ800F | NJ600N NJ800N NJ600H | NJV600F NJV800F | NJV600N NJV800N |
| ※締付トルク Tightening torque 0.7~0.9 N・m | | | | |

取付け Installation

| XCFN40A3 | XCFN80A3 |
|---|--|
| <p>端子カバー Terminal cover</p>  <p>ねじ Screw (M4×16) ※</p> <p>本体 MCCB or ELCB</p> <p>相間バリアは不要</p> | <p>端子カバー Terminal cover</p>  <p>ねじ Screw (M4×16) ※</p> <p>本体 MCCB or ELCB</p> |
| <p>外部操作ハンドル付の場合も端子カバーの取り付けは、上記と同一（スペーサは不要）になります。</p> | |

東芝産業機器システム株式会社

〒103-0023

東京都中央区日本橋本町4丁目9番11号（第9中央ビル）

Tel : (03) 5644-5502

URL <http://www.toshiba-tips.co.jp>

TOSHIBA INDUSTRIAL PRODUCTS SALES CORPORATION

9-11, Nihonbashi-honcho 4-Chome,

Chuo-ku, Tokyo, 103-0023 JAPAN

Tel : +81-3-5644-5502

URL <http://www.toshiba-tips.co.jp>